




# Fire Protection Training

Procedures Handbook 4300


## OPERATING PRINCIPLES OF STANDPIPE SYSTEMS

### Information Sheet #1

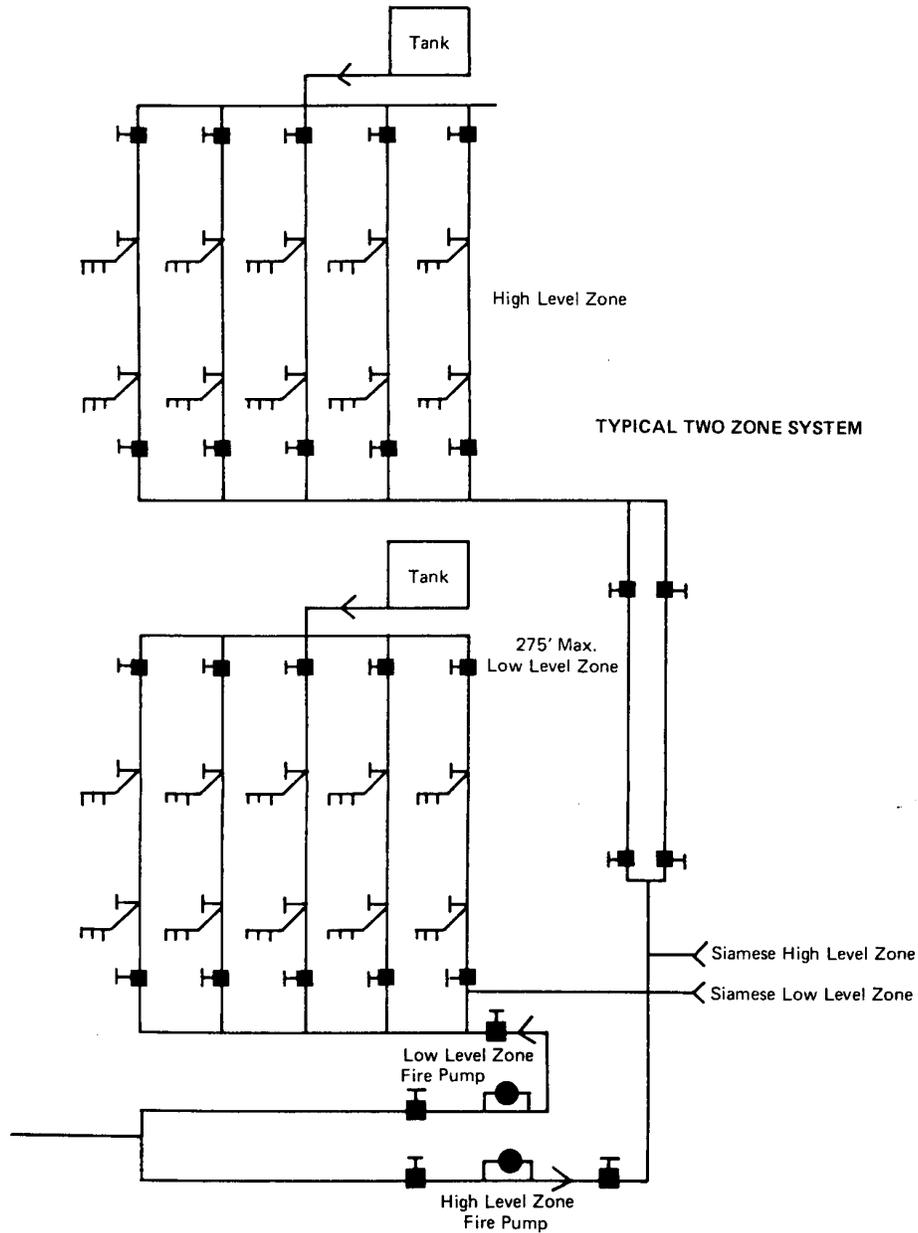




## Information Sheet #2

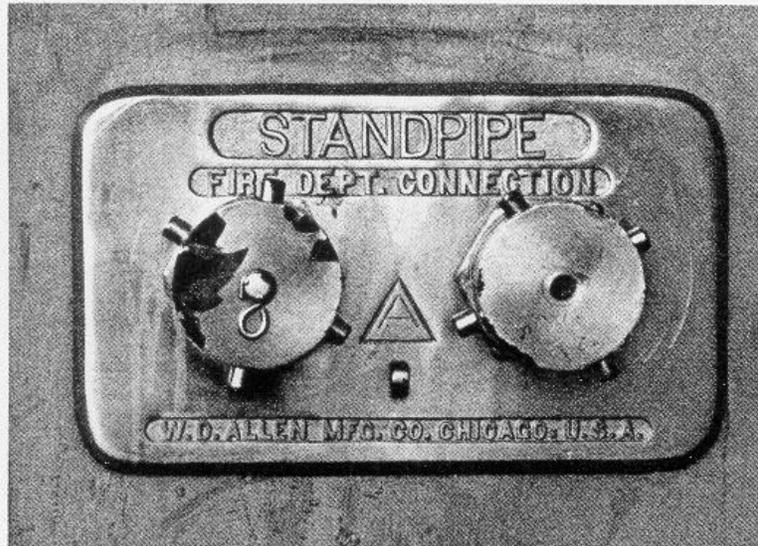

**Figure 2.18** The fire department connection should have a marking plate with raised lettering.

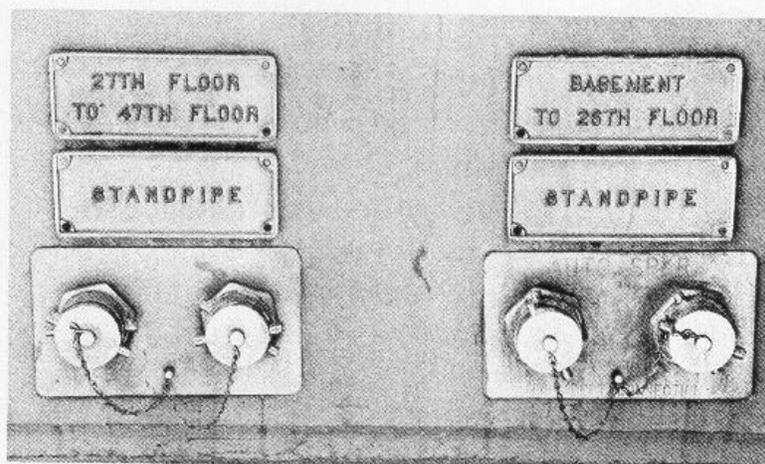

**Figure 2.16** Some fire department connections are designed to supply certain parts of the system.

Reprinted by permission from IFSTA "Private Fire Protection and Detection", 2<sup>nd</sup> Edition